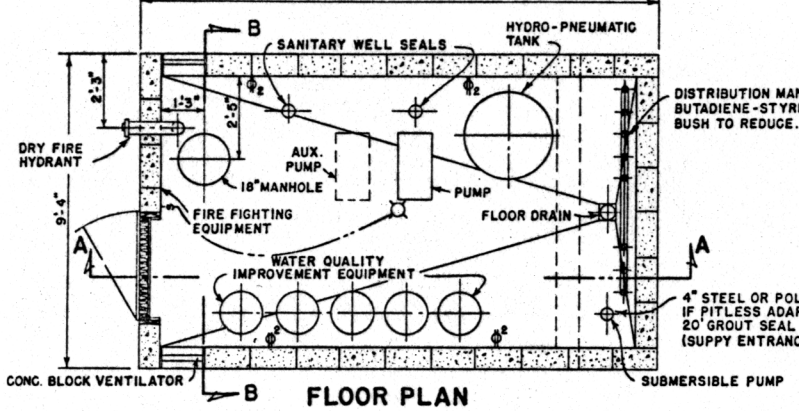

DISTRIBUTION MANIFOLD 2" 150 LB. ABS (ACRYLONTRILE BUTADIENE-STYRENE). ALL TEES 2"x2"x2". BUSH TO REDUCE. MINIMUM PIPE SIZE FOR DISTRIBUTION 1¼".

4" STEEL OR POLY VINYL CHLORIDE WELL CASING. IF PITLESS ADAPTER CANNOT BE USED 20' GROUT SEAL OR APPROVED EQUIVALENT. (SUPPY ENTRANCE)

FLOOR PLAN

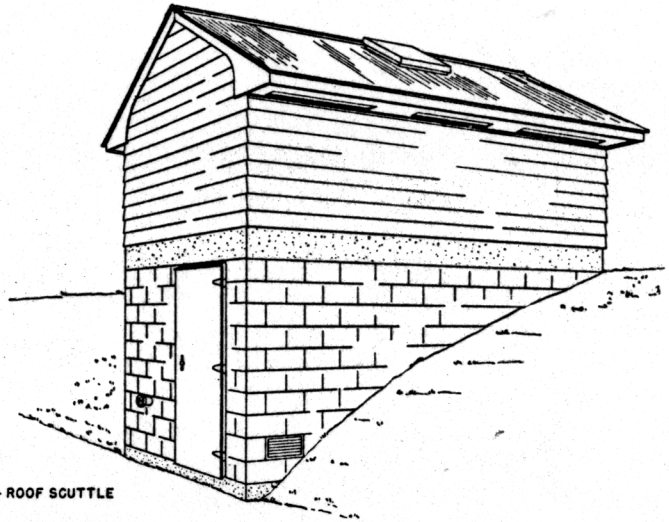

PERSPECTIVE VIEW

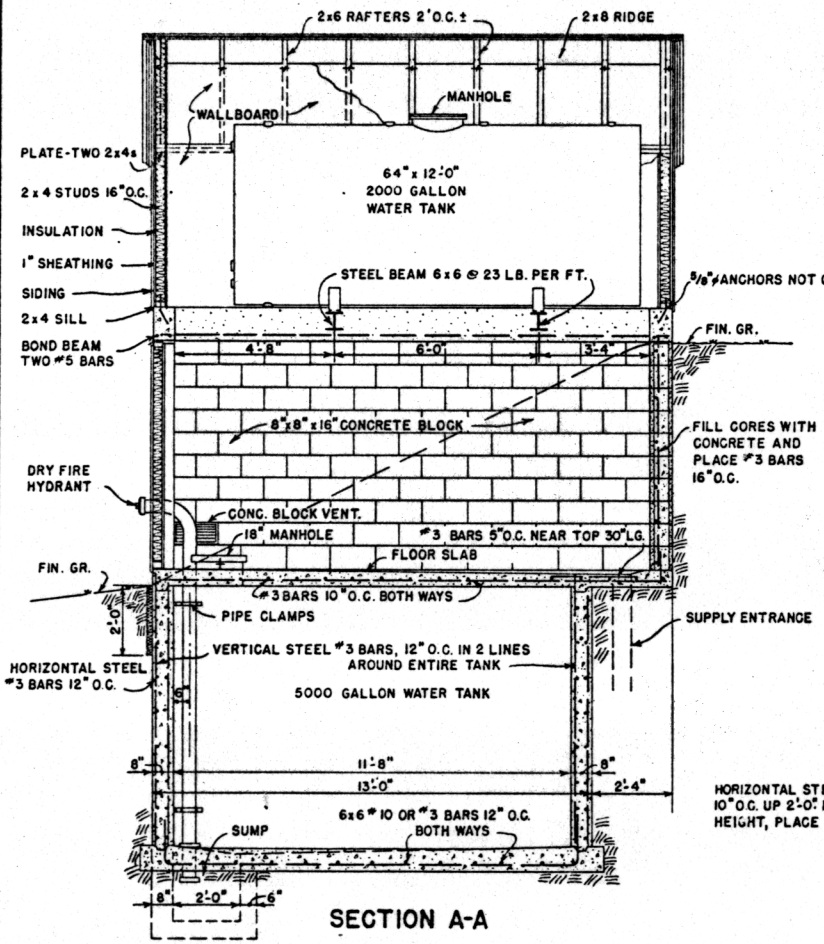

SECTION A-A

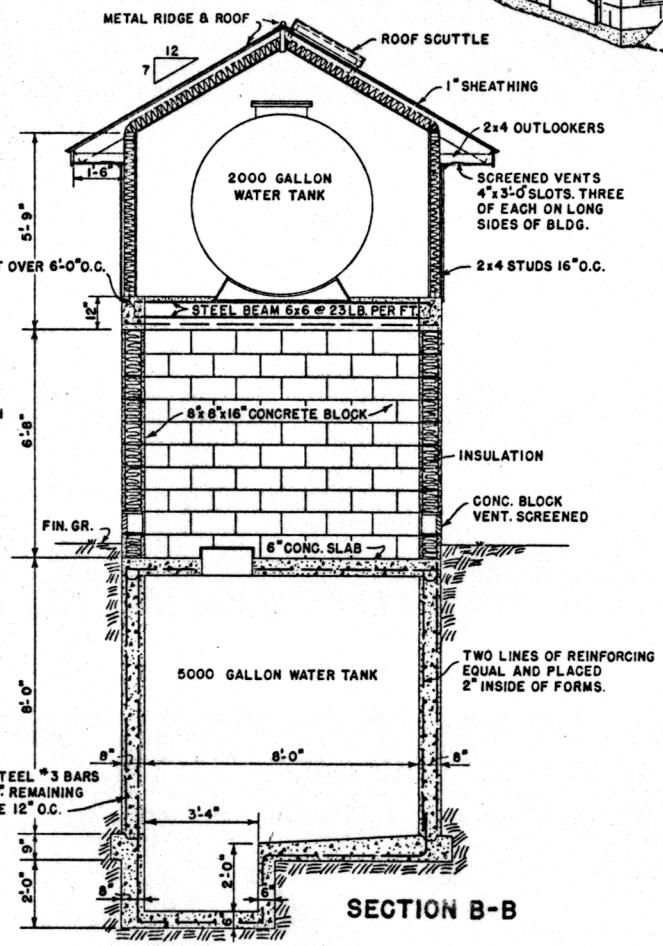

SECTION B-B

NOTES:

CHECK INSURANCE REGULATIONS FOR WATER STORAGE REQUIREMENTS.

PROVIDE GROUNDED DOUBLE CONVENIENCE OUTLETS.

WALLS AND ROOF OF BUILDING TO BE INSULATED IN LOCALITIES SUBJECT TO FREEZING TEMPERATURES.

EQUIP WITH ADEQUATE LIGHTNING PROTECTION SYSTEM IN AREAS WHERE NEEDED.

SCALE: 3/8" = 1'-0" UNLESS OTHERWISE NOTED.

COOPERATIVE EXTENSION WORK IN
AGRICULTURE AND HOME ECONOMICS
DEPARTMENT OF AGRICULTURAL ENGINEERING
UNIVERSITY OF MARYLAND
AND
UNITED STATES DEPARTMENT OF AGRICULTURE COOPERATING

FARMSTEAD WATER SUPPLY SYSTEM

USDA '63 | EX. 5963 | SHEET 1 OF 1