


PLAN

NOTES

1. CONSULT LOCAL HEALTH AUTHORITIES BEFORE STARTING CONSTRUCTION TO BE SURE THAT PLAN CONFORMS WITH LOCAL AND STATE REGULATIONS.
2. CONSULT WITH COW STALL MANUFACTURER PRIOR TO POURING MILKING PARLOR FLOOR AND PIT CURBING.
3. CONCRETE TO BE 3000 PSI AIR-ENTRAINED MIX TO POURING MILKING PARLOR FLOOR AND PIT FROST LINE.
4. FOOTINGS TO BEAR ON SOLID GROUND BELOW FROST LINE.
5. CONCRETE FLOORS TO HAVE A BROOD FINISH.
6. USE "CONSTRUCTION" GRADE DOUGLAS FIR OR NO. 1 SOUTHERN PINE, MINIMUM FIBER STRESS OF 1500 LB/50 IN., FOR TRUSSES AND GIRDER MEMBERS.
7. UNLESS OTHERWISE SPECIFIED, USE RING OR SPIRAL SHANK NAILS THROUGHOUT.

- DOOR AND WINDOW SCHEDULE
BULK ROOM & MILKING PARLOR
- ① 2'-4" x 6'-6"
 - ② 3'-0" x 6'-6"
 - ③ 3'-0" x 6'-8" WITH 4'-2-0" x 6'-8" REMOVABLE PANEL ADJACENT
 - ④ 3'-0" x 6'-8"
 - ⑤ CONSULT MANUFACTURERS SPECS
- 2'-2" x 12" GIRDER OVER THIS SPAN AT BOTH ENDS OF BUILDING - BRACE ACCORDING TO DETAIL A, SHEET 2

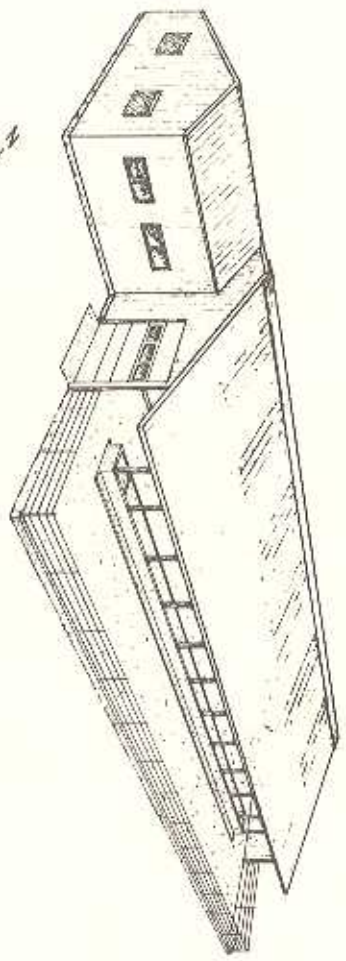

PERSPECTIVE