

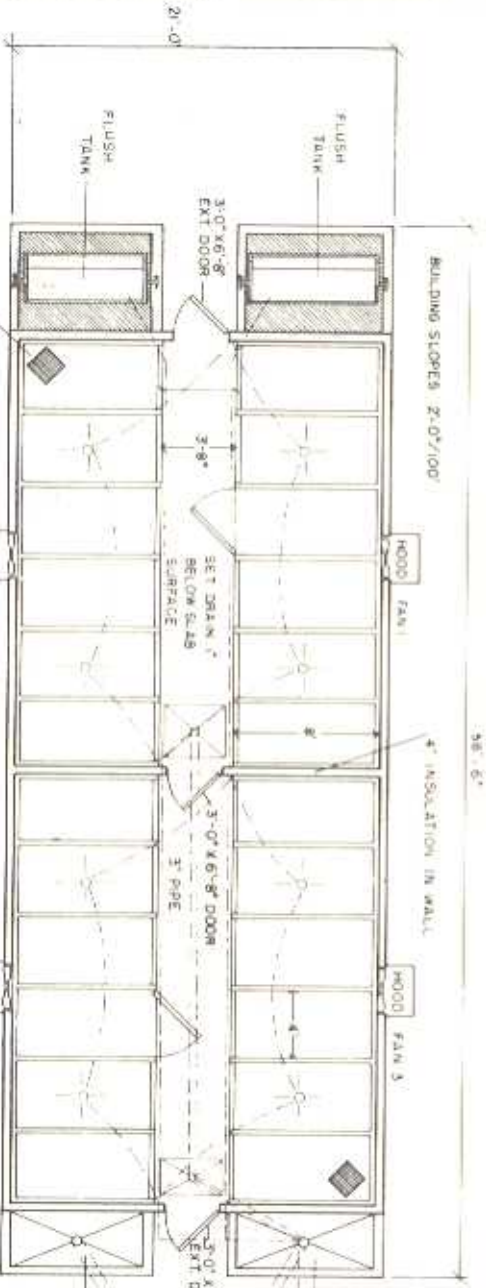


CROSS SECTION
 SCALE

■ HOT WEATHER
 FANS 1/3 CONTROLLED BY LOW SIDE OF 2" DIFFERENTIAL STEP THERMOSTAT FANS 2/3 CONTROLLED BY HIGH SIDE
 ■ COLD WEATHER
 USE TIME CLOCK TO OPERATE FANS 1/3 APPROX 20% OF TIME. THERMOSTAT FANS 2/3 IN (O) FOR MOISTURE REMOVAL AND TO MAINTAIN HUMIDITY AT 50-70% IN BUILDING. MAINTAIN TEMPERATURE 47°-50°

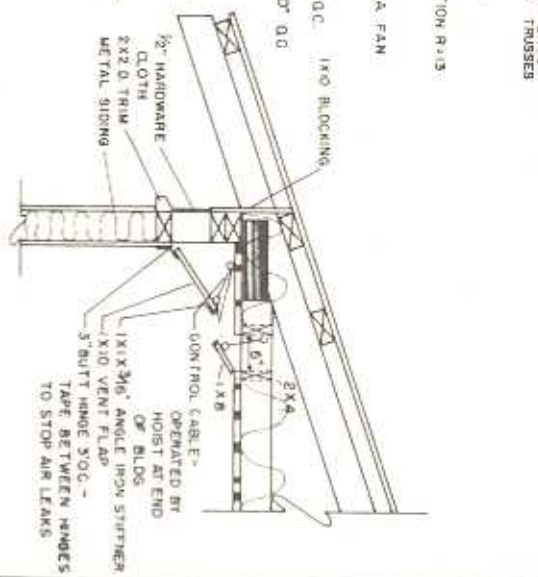

BUILDING SLOPES 2'-0"/100'
 36'-6"
 21'-0"
 60000 BTU HR
 CEILING MOUNTED FORCED AIR HEATER
 HOOD FAN 2
 HOOD FAN 3
 HOOD FAN 4
 ALL FANS 6000 CFM AT 1/2" S.P.
 12'-0" 2' 4" 7" SCALE

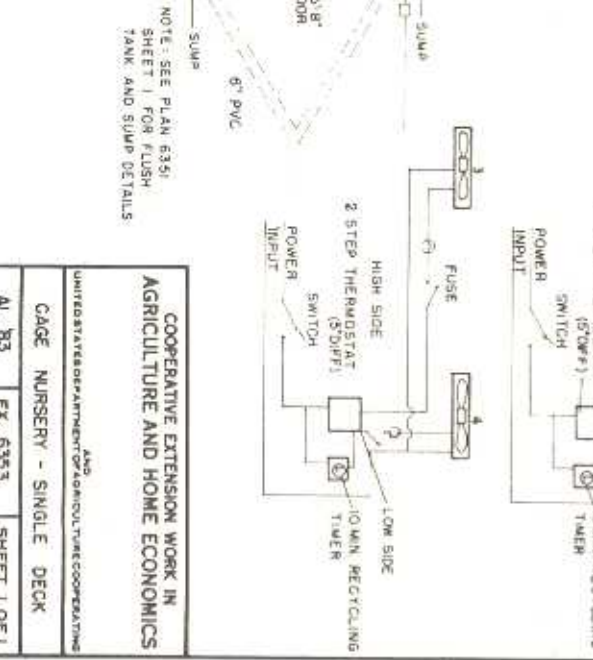

COOPERATIVE EXTENSION WORK IN
 AGRICULTURE AND HOME ECONOMICS
 UNITED STATES DEPARTMENT OF AGRICULTURE COOPERATING
 AND
 CAGE NURSERY - SINGLE DECK
 AL 83 EX 6353 SHEET 1 OF 1